

**NFRC 102-2010 THERMAL PERFORMANCE
TEST REPORT**

Rendered to:

UNITED STATES ALUMINUM

SERIES/MODEL: 7200

TYPE: Fixed

Summary of Results	
Standardized Thermal Transmittance (U-Factor)	0.35
Unit Size	47-1/4" x 59-1/8" (1200 mm x 1502 mm) (Model Size)
Layer 1	1/4" AFG Comfort TiAC36 (e=0.034*, #2)
Gap	0.52" Gap, Super Spacer Premium (ZF-S), 100% Air-Filled*
Layer 2	1/4" Clear

Reference must be made to Report No. A3701.01-301-46, dated 11/16/10 for complete test specimen description and data.

NFRC 102-2010 THERMAL PERFORMANCE TEST REPORT

Rendered to:

UNITED STATES ALUMINUM
200 Singleton Drive
Waxahachie, Texas 75165

Report Number: A3701.01-301-46
Test Date: 10/19/10
Report Date: 11/05/10
Revision 1 Date: 11/16/10
Test Record Retention Date: 10/19/14

Test Sample Identification:

Series/Model: 7200

Type: Fixed

Overall Size: 47-1/4" x 59-1/8" (1200 mm x 1502 mm) (Model Size)
NFRC Standard Size: 47.2" x 59.1" (1200 mm wide x 1500 mm high)

Test Sample Submitted by: Client

Test Sample Submitted for: Validation for Initial Certification (Production Line Unit)
& Plant Qualification

Test Procedure: U-factor tests were performed in a Guarded Hot Box in accordance with NFRC 102-2010, *Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems*.

Test Results Summary:

Standardized U-factor (U_{st}): 0.35 Btu/hr-ft²-F CTS Method

Test Sample Description:

CONSTRUCTION	Frame
Size (in.)	47-1/4 x 59-1/8
Daylight Opening (in.)	43-5/8 x 55-1/8
CORNERS	Coped
Fasteners	Screws
Sealant	Yes
MATERIAL	AT (0.24")
Color Exterior	Gray
Finish Exterior	Anodized
Color Interior	Gray
Finish Interior	Anodized
GLAZING METHOD	Exterior

Glazing Information:

Layer 1	1/4" AFG Comfort TiAC36 (e=0.034*, #2)
Gap	0.52" Gap, Super Spacer Premium (ZF-S), 100% Air-Filled*
Layer 2	1/4" Clear
Gas Fill Method	N/A*

**Stated per Client/Manufacturer*

N/A Non-Applicable

See Description Table Abbreviations

Test Sample Description: (Continued)

COMPONENTS		
Type	Quantity	Location
WEATHERSTRIP		
No weatherstrip		
HARDWARE		
No hardware		
DRAINAGE		
No visible drainage		

Thermal Transmittance (U-factor)

Measured Test Data

Heat Flows

1. Total Measured Input into Metering Box (Q_{total})	600.77 Btu/hr
2. Surround Panel Heat Flow (Q_{sp})	49.86 Btu/hr
3. Surround Panel Thickness	4.00 inches
4. Surround Panel Conductance	0.0437 Btu/hr·ft ² ·F
5. Metering Box Wall Heat Flow (Q_{mb})	34.83 Btu/hr
6. EMF vs Heat Flow Equation (equivalent information)	0.0243*EMF + -1.349
7. Flanking Loss Heat Flow (Q_{fl})	14.07 Btu/hr
8. Net Specimen Heat Loss (Q_s)	502.01 Btu/hr

Areas

1. Test Specimen Projected Area (A_s)	19.40 ft ²
2. Test Specimen Interior Total (3-D) Surface Area (A_h)	19.74 ft ²
3. Test Specimen Exterior Total (3-D) Surface Area (A_c)	20.27 ft ²
4. Metering Box Opening Area (A_{mb})	36.47 ft ²
5. Metering Box Baffle Area (A_{b1})	32.13 ft ²
6. Surround Panel Interior Exposed Area (A_{sp})	17.07 ft ²

Test Conditions

1. Average Metering Room Air Temperature (t_h)	69.81 F
2. Average Cold Side Air Temperature (t_c)	-0.74 F
3. Average Guard/Environmental Air Temperature	72.00 F
4. Metering Room Average Relative Humidity	13.94 %
5. Metering Room Maximum Relative Humidity	14.16 %
6. Metering Room Minimum Relative Humidity	13.74 %
7. Measured Cold Side Wind Velocity (Perpendicular Flow)	15.09 mph
8. Measured Static Pressure Difference Across Test Specimen	0.00" ± 0.04"H ₂ O

Results

1. Thermal Transmittance of Test Specimen (U_s)	0.37 Btu/hr·ft ² ·F
2. Standardized Thermal Transmittance of Test Specimen (U_{st})	0.35 Btu/hr·ft ² ·F

Thermal Transmittance (U-factor)

Calculated Test Data

CTS Method

1. Warm Side Emittance of Glass (e_i)	0.84
2. Cold Side Emittance of Glass	0.84
3. Warm Side Frame Emittance	0.80
4. Cold Side Frame Emittance	0.80
5. Warm Side Sash/Panel/Vent Emittance	N/A
6. Cold Side Sash/Panel/Vent Emittance	N/A
7. Warm Side Baffle Emittance (e_{bi})	0.92
8. Equivalent Warm Side Surface Temperature	52.14 F
9. Equivalent Cold Side Surface Temperature	4.35 F
10. Warm Side Baffle Surface Temperature	70.14 F
11. Measured Warm Side Surface Conductance (h_h)	1.46 Btu/hr·ft ² ·F
12. Measured Cold Side Surface Conductance (h_c)	5.08 Btu/hr·ft ² ·F
13. Test Specimen Thermal Conductance (C_s)	0.54 Btu/hr·ft ² ·F
14. Convection Coefficient (K_c)	0.34 Btu/(hr·ft ² ·F ^{1.25})
15. Radiative Test Specimen Heat Flow (Q_{ri})	264.64 Btu/hr
16. Conductive Test Specimen Heat Flow (Q_{ci})	237.37 Btu/hr
17. Radiative Heat Flux of Test Specimen (q_{ri})	13.64 Btu/hr·ft ² ·F
18. Convective Heat Flux of Test Specimen (q_{ci})	12.24 Btu/hr·ft ² ·F
19. Standardized Warm Side Surface Conductance (h_{sth})	1.22 Btu/hr·ft ² ·F
20. Standardized Cold Side Surface Conductance (h_{stc})	5.28 Btu/hr·ft ² ·F
21. Standardized Thermal Transmittance (U_{st})	0.35 Btu/hr·ft ² ·F

Test Duration

1. The environmental systems were started at 15:17 hours, 10/18/10.
2. The test parameters were considered stable for two consecutive four hour test periods from 21:18 hours, 10/18/10 to 05:18 hours, 10/19/10.
3. The thermal performance test results were derived from 01:18 hours, 10/19/10 to 05:18 hours, 10/19/10.

The reported Standardized Thermal Transmittance (U_{st}) was determined using CTS Method, per Section 8.2(A) of NFRC 102.

Glazing Deflection (in):

	Glazing
Edge Gap Width	0.52
Estimated center gap width upon receipt of specimen in laboratory (after stabilization)	0.27
Center gap width at laboratory ambient conditions on day of testing	0.52
Center gap width at test conditions	0.52

Glass collapse determined using a digital glass and air space meter

The sample was inspected for the formation of frost or condensation, which may influence the surface temperature measurements. The sample showed evidence of condensation at the sill and the bottom half of the jambs at the conclusion of the test.

A full calibration of the Architectural Testing Inc. 'thermal test chamber' (ICN 004287) in Fresno, California was conducted in April 2010 in accordance with Architectural Testing Inc. calibration procedure. A calibration check was performed September 2010.

"This test method does not include procedures to determine the heat flow due to either air movement through the specimen or solar radiation effects. As a consequence, the thermal transmittance results obtained do not reflect performances which may be expected from field installations due to not accounting for solar radiation, air leakage effects, and the thermal bridge effects that may occur due to the specific design and construction of the fenestration system opening. Therefore, it should be recognized that the thermal transmittance results obtained from this test method are for ideal laboratory conditions and should only be used for fenestration product comparisons and as input to thermal performance analyses which also include solar, air leakage and thermal bridge effects."

"Ratings included in this report are for submittal to an NFRC-licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) are to be used for labeling purposes."

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side. The direction of heat transfer was from the interior (warm side) to the exterior (cold side) of the specimen.

ANSI/NCSL Z540-2-1997 type B uncertainty for this test was 2.03%.

Detailed drawings, data sheets, representative samples of test specimens, a copy of this report, or other pertinent project documentation will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period such materials shall be discarded without notice and the service life of this report by Architectural Testing will expire. Results obtained are tested values and were secured by using the designated test methods. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Ratings included in this report are for submittal to an NFRC licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) are to be used for labeling purposes. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC.

Tested By:

Reviewed By:

Simon Smeds
Technician

Kenny C. White
Laboratory Manager
Individual-In-Responsible-Charge

WSS:ss
A3701.01-301-46

Attachments (pages): This report is complete only when all attachments listed are included.

- Appendix-A: Description Table Abbreviations (1)
- Appendix-B: CTS Calibration Data (1)
- Appendix-C: Surround Panel Wiring Diagram (1)
- Appendix-D: Baffle Wiring Diagram (1)
- Appendix-E: Submittal Form and Drawings (7)

Revision Log

Rev. #	Date	Page(s)	Revision(s)
0	11/05/10	All	Original Report Issue. Work requested by Mr. Don Willard of United States Aluminum
1	11/16/10	11-14	Removed header

Appendix A: Description Table Abbreviations

CODE	Frame / Sash Types
AI	Aluminum w/ Vinyl Inserts (Caps)
AL	Aluminum
AP	Aluminum w/ Thermal Breaks - Partial
AS	Aluminum w/ Steel Reinforcement
AT	Aluminum w/ Thermal Breaks - All Members (≥ 0.21 ")
AU	Aluminum Thermally Improved - All Members (0.062" - 0.209")
AV	Aluminum / Vinyl Composite
AW	Aluminum-clad Wood
FG	Fiberglass
PA	ABS Plastic w/ All Members Reinforced
PC	ABS Plastic-clad Aluminum
PF	ABS Plastic w/ Foam-filled Insulation
PH	ABS Plastic w/ Horizontal Members Reinforced
PI	ABS Plastic w/ Reinforcement - Interlock
PL	ABS Plastic
PP	ABS Plastic w/ Reinforcement - Partial
PV	ABS Plastic w/ Vertical Members Reinforced
PW	ABS Plastic-clad Wood
ST	Steel
VA	Vinyl w/ All Members Reinforced
VC	Vinyl-clad Aluminum
VF	Vinyl w/ Foam-filled Insulation
VH	Vinyl w/ Horizontal Members Reinforced
VI	Vinyl w/ Reinforcement - Interlock
VP	Vinyl w/ Reinforcement - Partial
VV	Vinyl w/ Vertical Members Reinforced
VW	Vinyl-clad Wood
VY	Vinyl
WA	Aluminum / Wood composite
WD	Wood
WV	Vinyl / Wood composite
WF	Fiberglass/Wood Combination
WC	Composite/Wood Composite (Shaped vinyl/wood composite members)
CW	Copper Clad Wood
CO	Vinyl/Wood Composite Material

CODE	Spacer Types (See sealant)
A1	Aluminum
A2	Aluminum (Thermally-broken)
A3	Aluminum-reinforced Polymer
A4	Aluminum / Wood
A5	Aluminum-reinforced Butyl (Swiggle)
A6	Aluminum / Foam / Aluminum
A7	Aluminum U-shaped
A8	Aluminum-Butyl (Corrugated) (Duraseal)
ER	EPDM Reinforced Butyl
FG	Fiberglass
GL	Glass
OF	Organic Foam
P1	Duralite
PU	Polyurethane Foam
SU	Stainless Steel, U-shaped
CU	Coated Steel, U-shaped (Intercept)
S2	Steel (Thermally-broken)
S3	Steel / Foam / Steel
S5	Steel-reinforced Butyl
S6	Steel U-channel w/ Thermal Cap
SS	Stainless Steel
CS	Coated Steel
TP	Thermo-plastic
WD	Wood
ZE	Elastomeric Silicone Foam
ZF	Silicone Foam
ZS	Silicone / Steel
N	Not Applicable
TS	Thermo-plastic w/ stainless steel substrate

CODE	Tint Codes
AZ	Azurlite
BL	Blue
BZ	Bronze
CL	Clear
EV	Evergreen
GD	Gold
GR	Green
GY	Gray
LE	Low 'e' Coating
OT	Other (use comment field)
RC	Solar or Reflective Coating
RG	Roller Shades between glazing
RS	Silver (reflective coating)
SF	Suspended Polyester Film
SR	Silver
BG	Blinds between the Glazing
DV	Dynamic Glazing-Variable
DY	Dynamic Glazing-NonVariable

CODE	Gap Fill Codes
AIR	Air
AR2	Argon/Krypton Mixture
AR3	Argon / Krypton / Air
ARG	Argon/Air
CO2	Carbon Dioxide
KRY	Krypton/Air
SF6	Sulfur Hexafluoride
XE2	Xenon/Krypton/Air
XE3	Xenon/Argon/Air
XEN	Xenon/Air
N	Not Applicable

DOOR DETAILS	
N	Not Applicable
CODE	Door Type
EM	Embossed
FL	Flush
LF	Full Lite
LH	1/2 - Lite
LQ	1/4 - Lite
LT	3/4 - Lite
RP	Raised Panel
CODE	Skin
AL	Aluminum
FG	Fiberglass
GS	Galvanized Steel
ST	Steel
WD	Wood
VY	Vinyl
CODE	Panel
FG	Fiberglass
PL	Plastic
WP	Wood - Plywood
WS	Wood - Solid
CODE	Sub-Structure
GS	Galvanized Steel
ST	Steel
WD	Wood
VY	Vinyl
CODE	Core Fill
CH	Cellular - Honeycomb
EP	Expanded Polystyrene
PI	Polyisocyanurate
PU	Polyurethane
WP	Wood - Plywood
WS	Wood - Solid
XP	Extruded Polystyrene

CODE	Spacer Sealant
D	Dual Seal Spacer System
S	Single Seal Spacer System

CODE	Grid Description
N	No Muntins
G	Grids between glass
S	Simulated Divided Lites
T	True Muntins


CODE	Grid Size Codes
	Blank for no grids
0.75	Grids < 1"
1.5	Grids \geq 1"

CODE	Thermal Breaks
F	Foam
U	Urethane
V	Vinyl
FB	Fiberglass
O	Other
AB	ABS
NE	Neoprene
AI	Air
N	Not Applicable
P	Polyamide


Appendix B: CTS Calibration Data

1. CTS Test Date	02/23/10
2. CTS Size	24.00 ft ²
3. Glass Conductance	57.78 Btu/hr·ft ² ·F
4. CTS Core Conductance	0.33 Btu/hr·ft ² ·F
5. Warm Side Air Temperature	69.80 F
6. Cold Side Air Temperature	-0.33 F
7. Warm Side Average Surface Temperature	56.80 F
8. Cold Side Average Surface Temperature	3.41 F
9. Convection Coefficient (K _c)	0.34 Btu/(hr·ft ² ·F ^{1.25})
10. Measured Cold Side Surface Conductance (h _c)	5.08 Btu/hr·ft ² ·F
11. Measured Thermal Transmittance	0.26 Btu/hr·ft ² ·F

Appendix C: Surround Panel Wiring Diagram

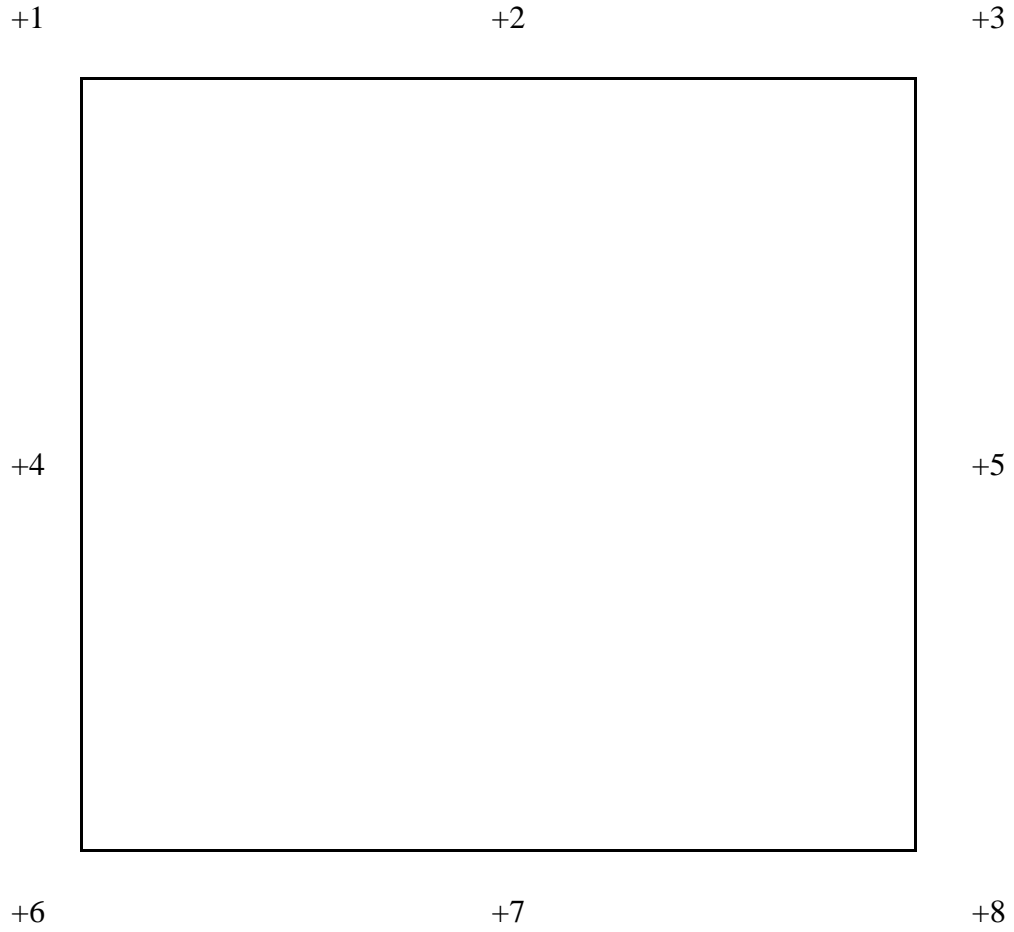

Appendix D: Baffle Wiring Diagram

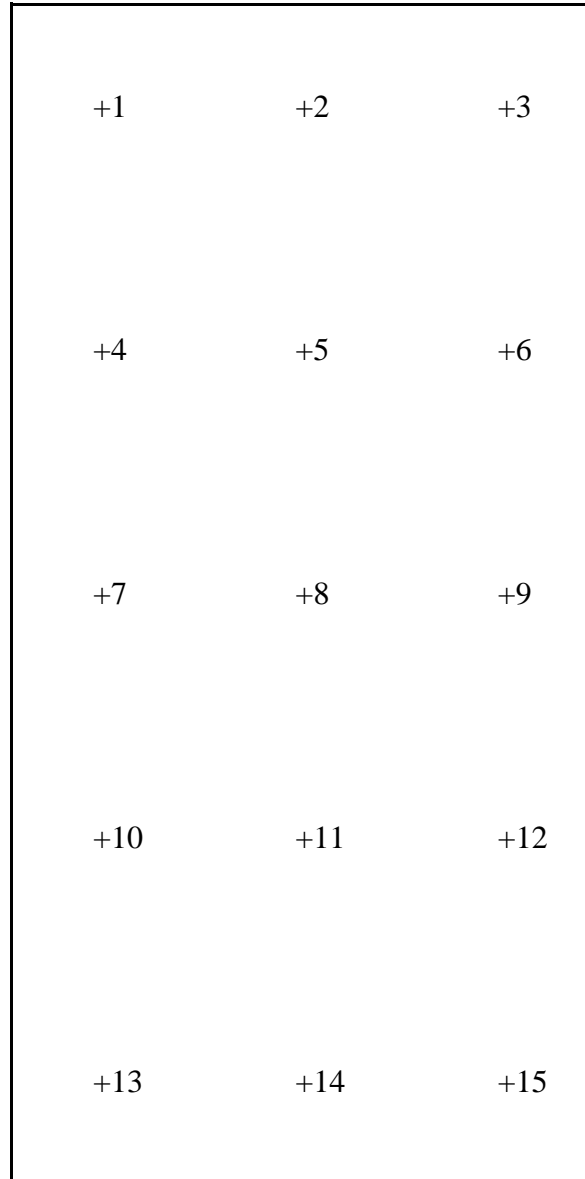


Appendix E: Submittal Form and Drawings

NFRC PRODUCT CERTIFICATION PROGRAM

Submittal Form for Test Samples

For use by manufacturers, lineal suppliers and fabricators



National Fenestration
Rating Council®

1. Information on Production of the Test Sample (complete ALL fields):

Manufacturer: United States Aluminum Date of sample manufacture: 10.11.10

Plant Address where manufactured: 200 Singleton Dr

City: Waxahachie State: Texas Zip Code: 75165

Name of IA: ALI Phone: _____ Fax: _____

2. Product Information (complete ALL fields):

Product Line ID (CPD) No.: _____ Product/Operator Type
(Table 4-3 of NFRC 100): _____

Series/Model: 7200 Fixed

3. Test sample is being submitted for (select ONE):

- a. Validation for Initial Certification (prototype only) no plant qualification
- b. Validation for Initial Certification (production line unit) & plant qualification
- c. Validation for Recertification (production line unit) & plant qualification
- d. Plant Qualification Only (production line unit)

I, Don Willard, as the designated agent for United States Alum

do hereby attest that the foregoing information is true to the best of my information, knowledge, and belief. Further, if the unit is identified in Section 3 as a production line unit, I hereby authorize the NFRC-accredited testing laboratory to send a copy of the test report to the IA identified above for plant qualification purposes pursuant to the NFRC Product Certification Program..

Signature: Don Willard Date: 10.27.10

FOR LABORATORY USE ONLY

- 1. Laboratory: Architectural Testing, Inc
- 2. Date Sample Received: 10/18/10 File number ID: AJ3701.01-301-46
- 3. Date Sample Tested: 10/19/10 By: William Smeds
- 4. Modifications made: IGU drilled prior to testing. Initial center deflection exceeded allowable.
- 5. Reason for non-testing of sample unit: N/A

[Note: If the sample submitted can not be tested due to damage prior to testing, a new sample and new form shall be submitted to the testing laboratory. Both forms shall be submitted to the IA when the testing is completed.]

Bill of Materials

International Architectural Products, Inc. 7200 Fixed Window

<u>Part Name</u>	<u>Part Number</u>
Frame	CC203
Glazing Bead	CC208
Wedge Gasket	WH344



Architectural Testing, Inc.
Test sample complies with these details
deviations are noted

A 3 7 0 1

OCT 28 2010

Report #
Tech

Date



Architectural Testing, Inc.
Test sample complies with these details
deviations are noted


A 3 7 0 1

OCT 28 2010

Report #

Tech


Date

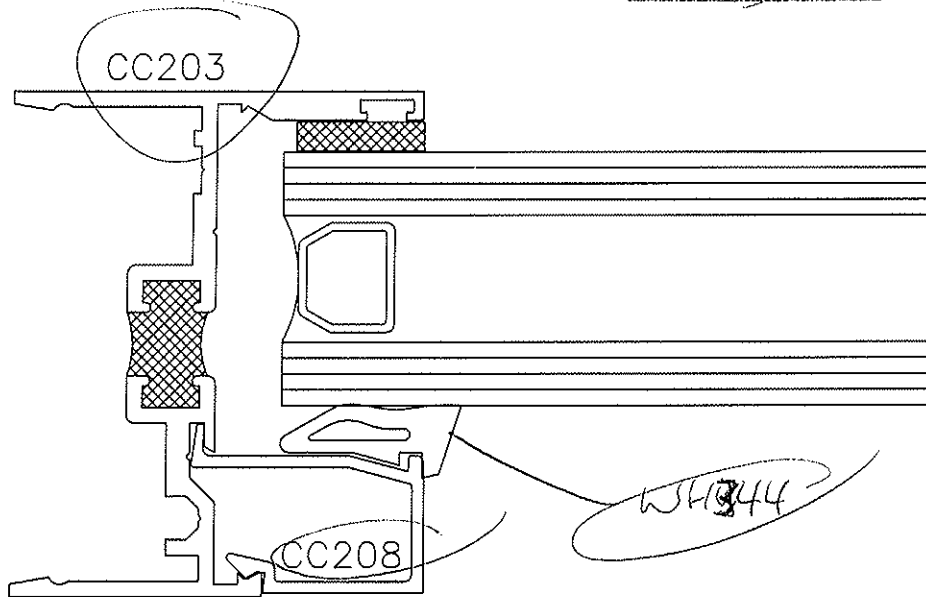



A1	REVISED W/7/87	EON89118	GLH
A2	REVISED W/7/87	EON89118	GLH

SECTION PROPERTIES:

- 4
- $I_{xx} = 0.216$ in
- 3
- $S_{xx} = 0.194$ in
- 4
- $I_{yy} = 0.042$ in
- 3
- $S_{yy} = 0.046$ in

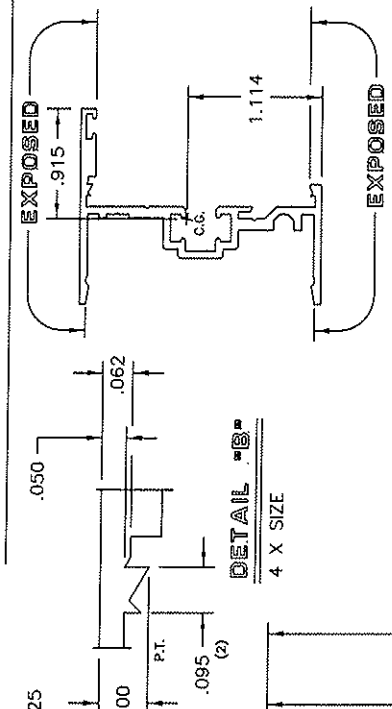

ACTUAL SIZE

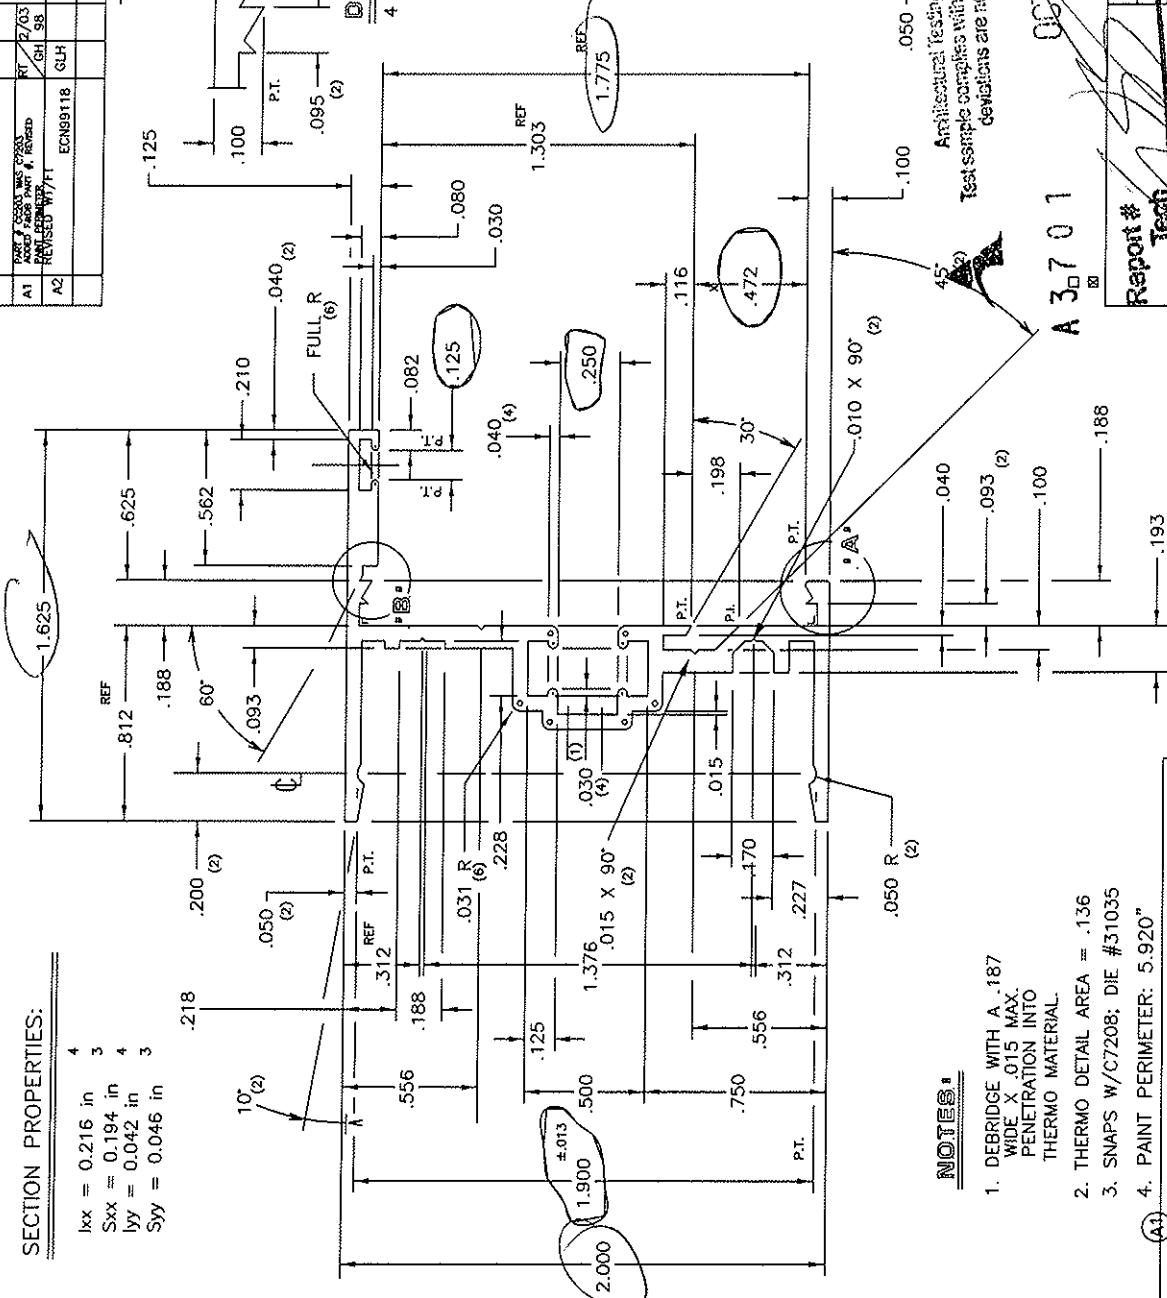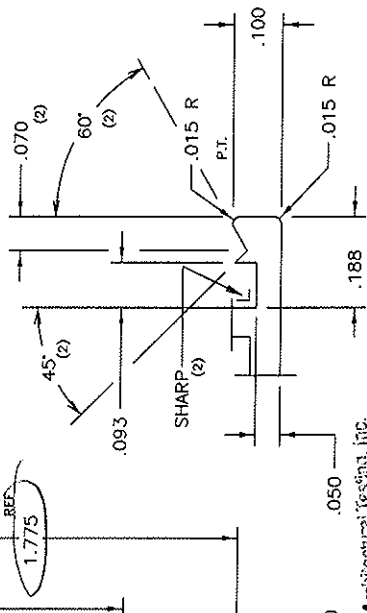

NOTES:

1. DEBRIDGE WITH A .187 WIDE X .015 MAX. PENETRATION INTO THERMO MATERIAL.
2. THERMO DETAIL AREA = .136
3. SNAPS W/C7208; DIE #31035
4. PAINT PERIMETER: 5.920"
5. F&DB PART CT203

Architectural Testing, Inc.
 Test sample complies with these details
 deviations are noted

DETAIL A



A 3701

Report #	Date	P-21359	2
Tech		2.600	9X30983
		12.510	B02-35
		26	7" = 51
			T-31031 A2

PART # CC208 WAS C7208 REVISED W/77 ECN98118		REV 2705 GH 98 7/74 GLH 199		U. S. ALUMINUM CORP.		T-31043 A2	
1" GLAZING BEAD		MAMO		3/25/93			
CC208 (A1)		4X SIZE					

NOTES:

- SNAPS WITH: C7206, DIE #31033; C7225, DIE #31038
C7207, DIE #31034; C7226, DIE #
C7204, DIE #31032; C7227, DIE #
C7205, DIE #31039; C7228, DIE #
C7202, DIE #31030; C7229, DIE #
C7203, DIE #31031; C7217, DIE #
C7213, DIE #31036; C7201, DIE #31029
- PAINT PERIMETER: 1.138"

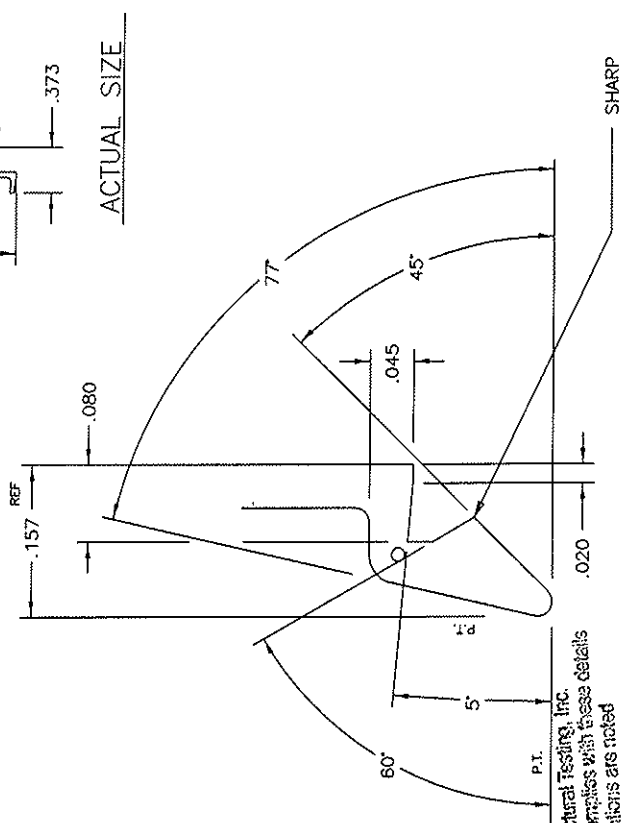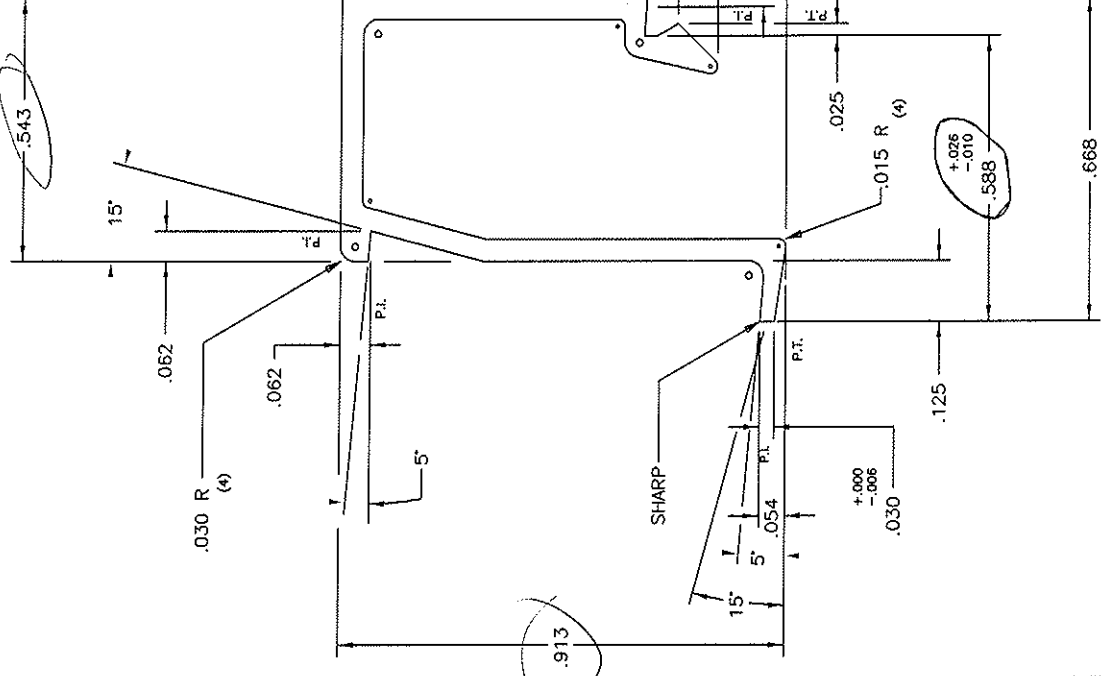

Architectural Testing, Inc.
Test samples compares with these details
deviations are noted

ENLARGED DETAIL

A 3 7 0 1
OCT 28 2010
SCALE: 8X SIZE

Report # _____ Date _____
Tech _____

.107	P--21364	5 WELDING	.045
.128	1.100	9 X 31043	
4.712	SOLID	B05-7	
37	7 77	T-31043 A2	

USA-1819 B

Architectural Testing, Inc.
Test samples comply with these details
deviations are noted




ACTUAL SIZE

OCT 28 2010

Date

A 3701


Report #
Tech

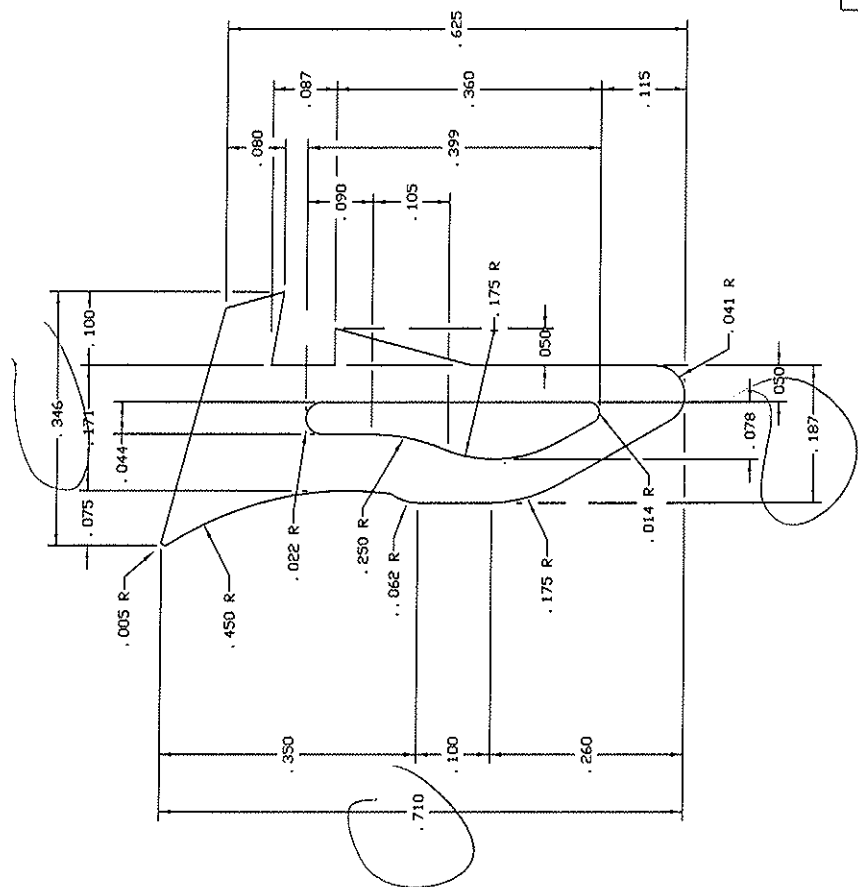

- NOTE:
1. FACE CLEARANCE = .188
 2. BURDMETER = 70 ±5
 3. MATERIAL: EPDM
 4. TRENCH PS-1126E OR EQUAL
 5. SILICONE BATH.

International Aluminum Corporation		DIVISION		DWG NO.	
U.S. ALUMINUM CORP.		ENGR BY		USA-1819 B	
PART NO. WH344		DATE		WEDGE GASKET For	
ADD SILICONE BATH NOTE		7/20/99		7800 WINDOWS & ES350	
REV		DATE		SCALE	
1		8 X SIZE			

SUPER SPACER

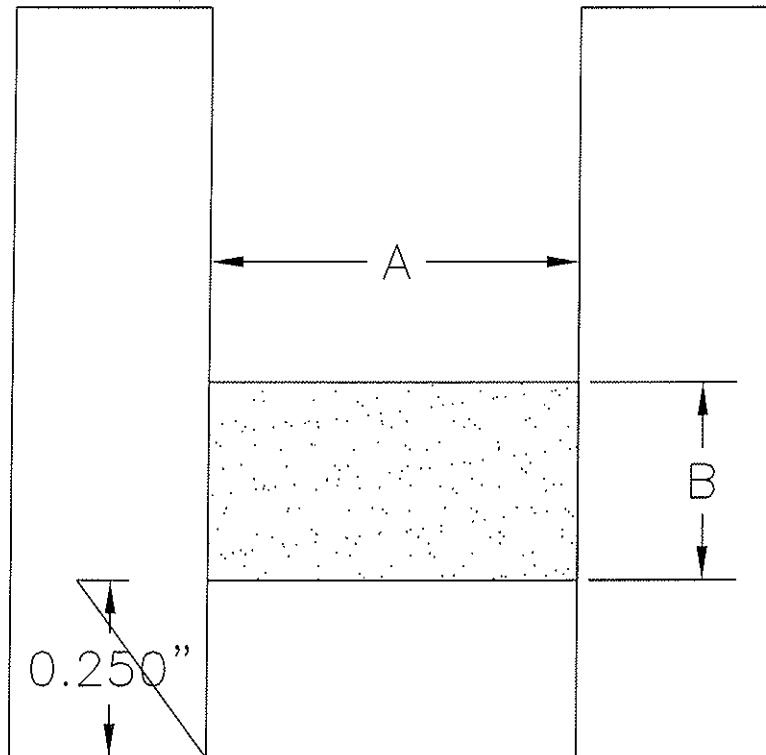

Architectural Testing, Inc.
Test sample complies with these details
deviations are noted

A 3 7 0 1

OCT 28 2010

Report #
Tech

Date

Offset: None
Primary Sealant: Butyl Rubber
Secondary Sealant: None
Material: Silicone Foam
Width (A): 0.500"
Height (B): 0.188"